


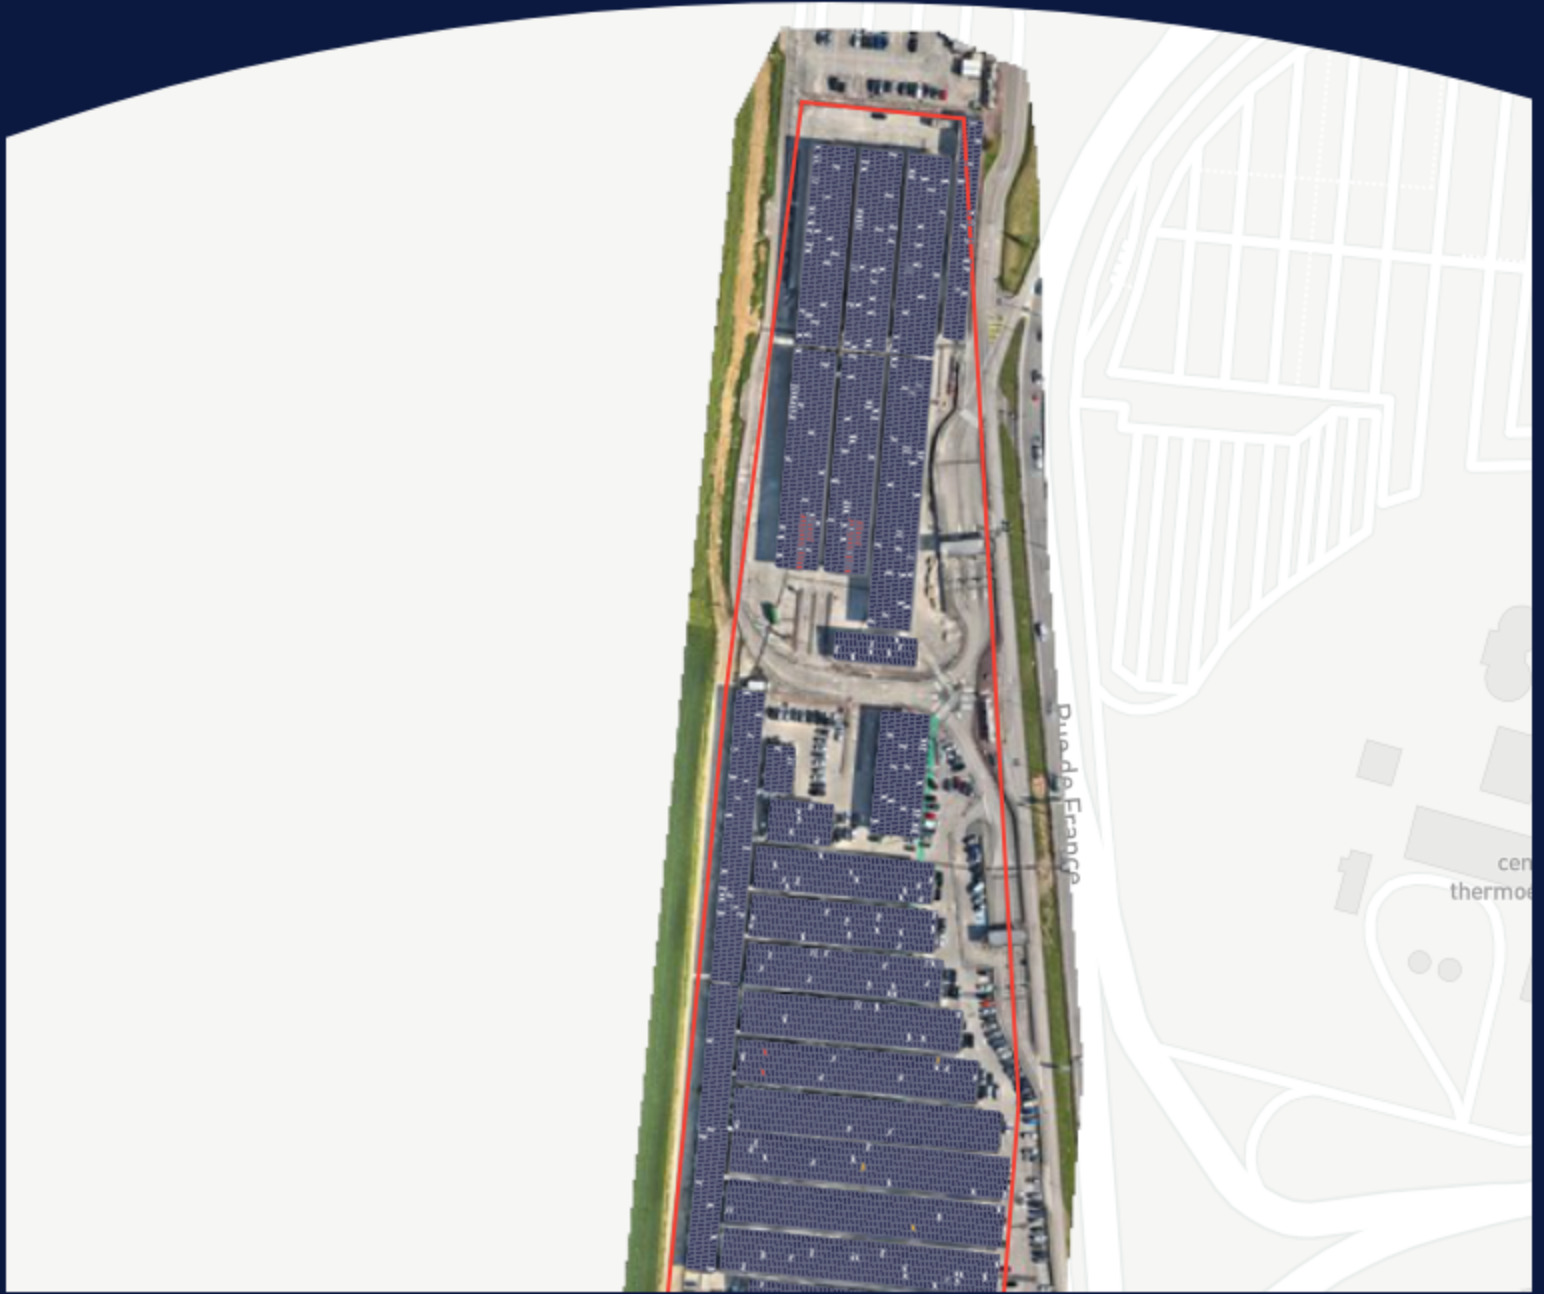

INSPECTION REPORT

Inspected on 2025-04-28 10:05

Generated on 2025-05-12 13:20 by outlier


Overview




Overall location




Precize location

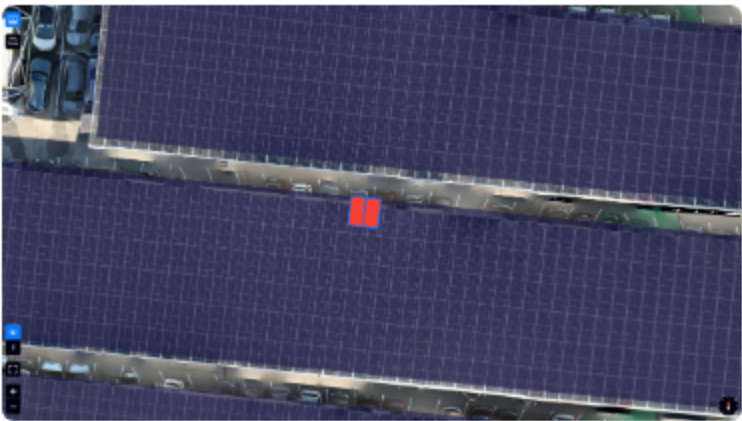

Anomaly zoom

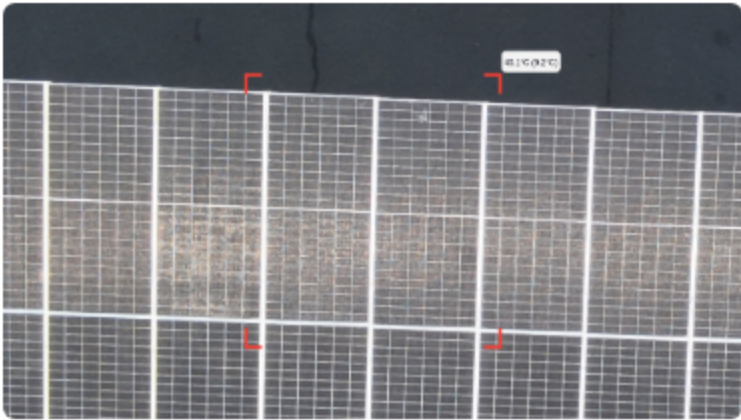

Anomaly zoom - Thermal view

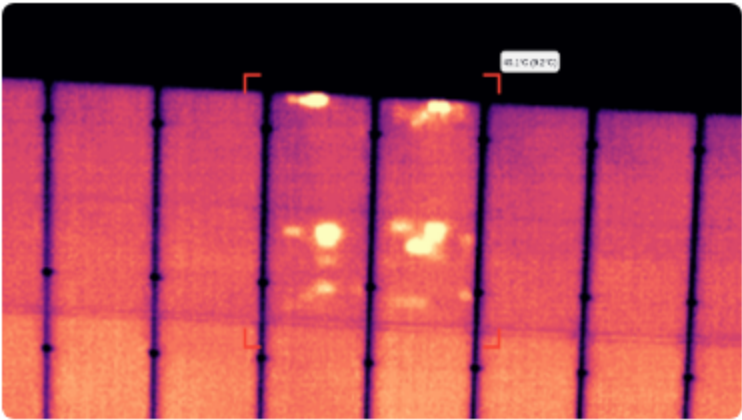

Estimated losses

After 0/12 repairs	0€/y
--------------------	------

Properties

Position	-
Severity	Major
Type	Mixed
Subtype	-
Repair	To Repair

Comments

outlier
Nombreux hotspots possiblement dus à de l'encrassement mais à vérifier.
12.05.2025, 09:51 a.m.


Details

Temperature Difference	+9.2°C
Average Temperature	35.9°C
Surface Affected (thermal)	115.8%
Surface Affected (visual)	1.1%


Overall location




Precize location

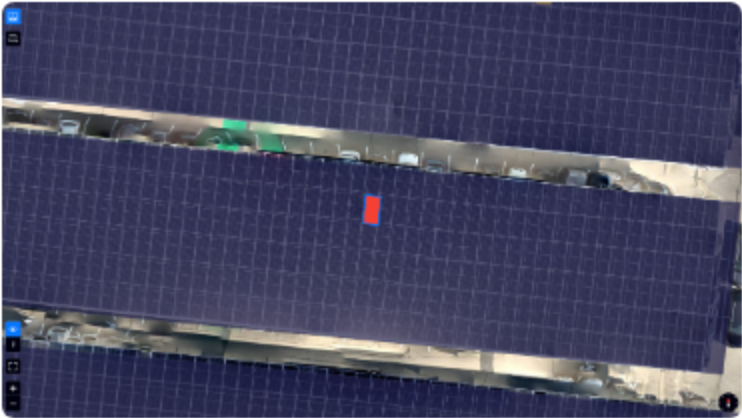

Anomaly zoom

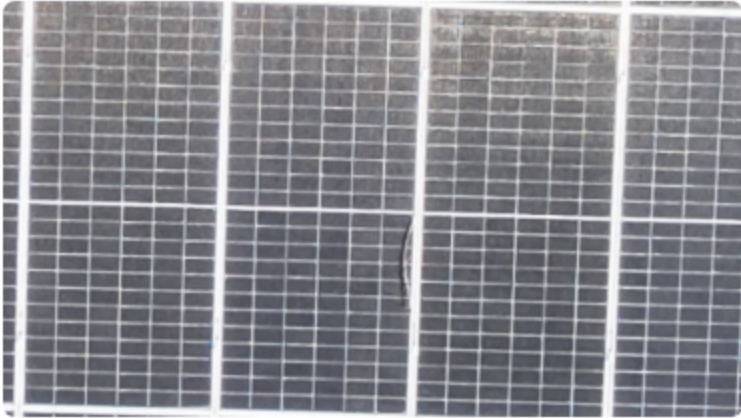

Anomaly zoom - Thermal view

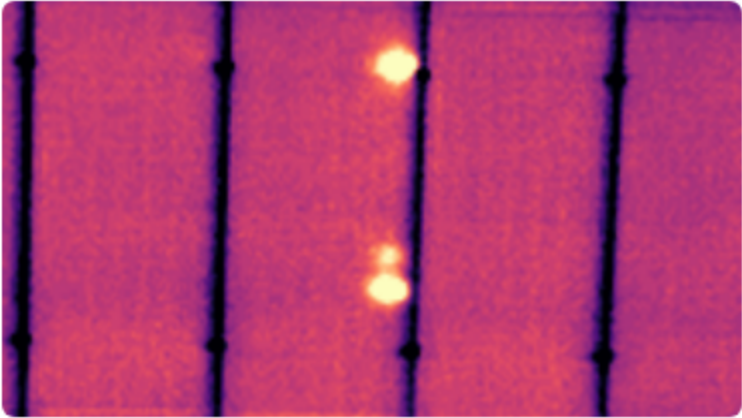

Estimated losses

After 0/12 repairs	0€/y
--------------------	------

Properties

Position	-
Severity	Major
Type	Mixed
Subtype	-
Repair	To Repair

Comments

outlier
Multiples hotspots de plus de 10°C dus apparemment à un câble mal positionné.
12.05.2025, 09:50 a.m.

Details

Temperature Difference	+10.8°C
Average Temperature	34.6°C
Surface Affected (thermal)	46.1%
Surface Affected (visual)	3.1%


Overall location




Precize location



Anomaly zoom

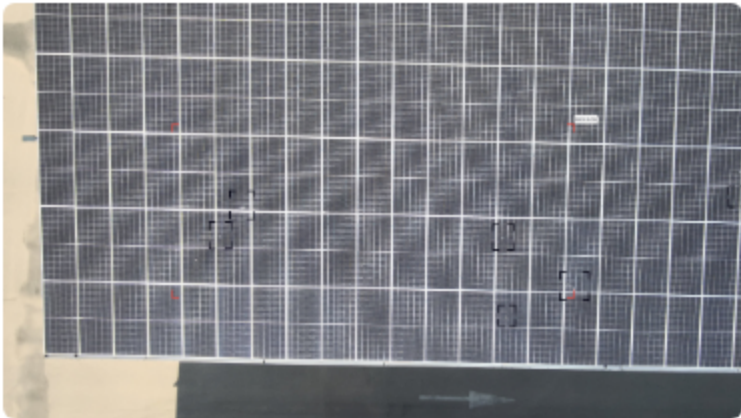

Anomaly zoom - Thermal view

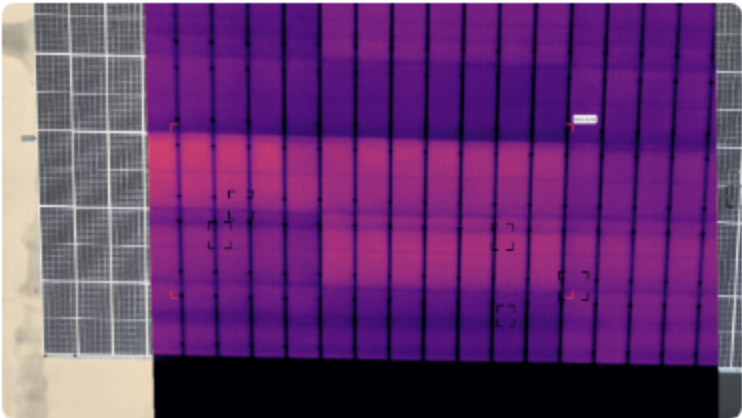

Estimated losses

After 0/12 repairs	0€/y
--------------------	------

Properties

Position	-
Severity	Major
Type	Strings
Subtype	-
Repair	Delayed

Details

Temperature Difference	+6.4°C
Average Temperature	44.4°C
Panels Affected	21

Comments

outlier
String déséquilibrée. A vérifier.
12.05.2025, 09:47 a.m.

Overall location




Precize location



Anomaly zoom



Anomaly zoom - Thermal view

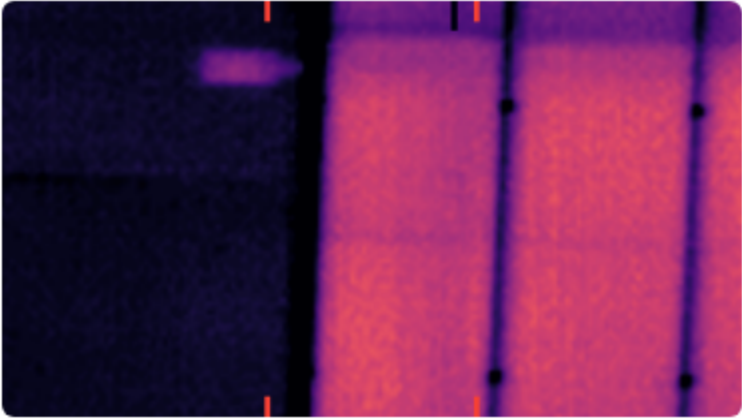

Estimated losses

After 0/12 repairs	0€/y
--------------------	------

Properties

Position	-
Severity	Major
Type	Strings
Subtype	-
Repair	Delayed

Details

Temperature Difference	+4.4°C
Average Temperature	47.7°C
Panels Affected	1


Comments

outlier
String déséquilibrée. A vérifier.
12.05.2025, 09:53 a.m.


Overall location




Precize location

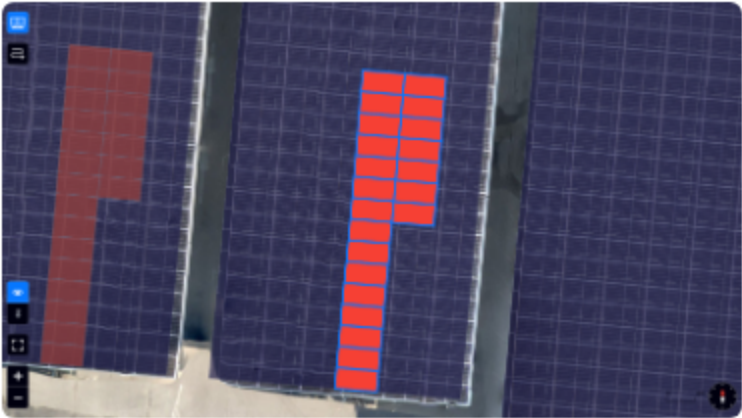

Anomaly zoom

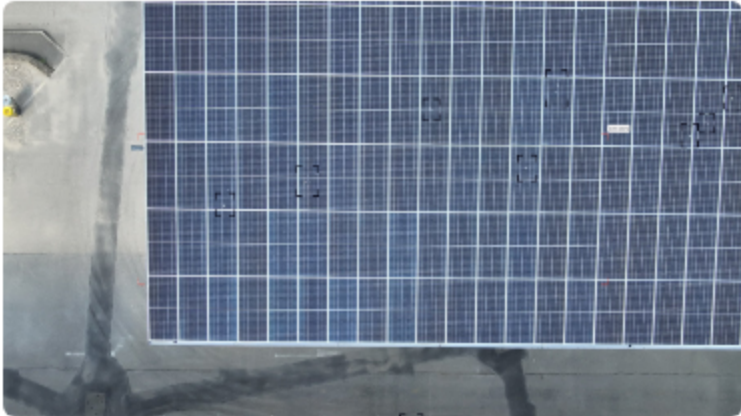

Anomaly zoom - Thermal view

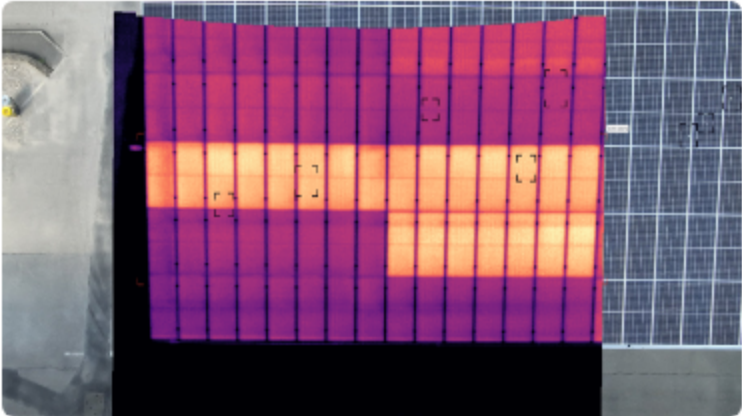

Estimated losses

After 0/12 repairs	0€/y
--------------------	------

Comments

outlier
String déséquilibrée. A vérifier.
12.05.2025, 09:53 a.m.

Properties

Position	-
Severity	Major
Type	Strings
Subtype	-
Repair	Delayed


Details

Temperature Difference	+13.2°C
Average Temperature	49°C
Panels Affected	22


Overall location




Precize location

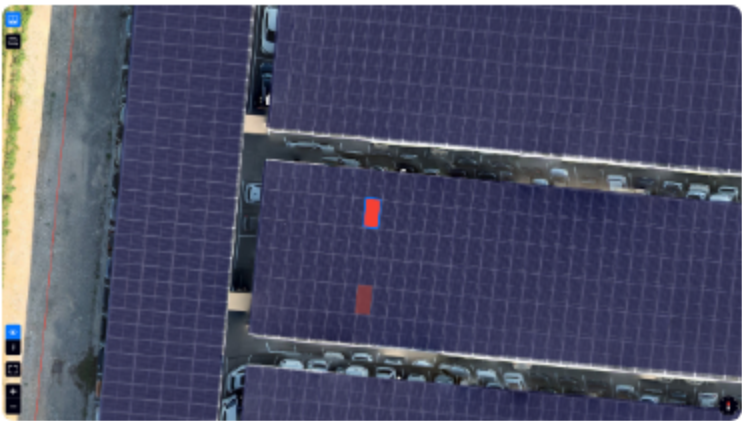

Anomaly zoom

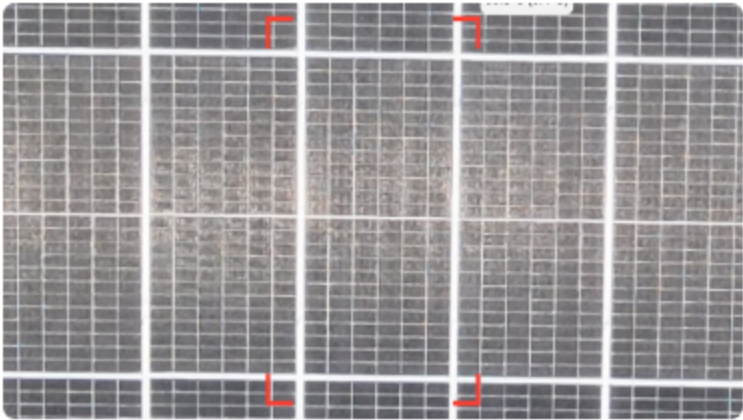

Anomaly zoom - Thermal view

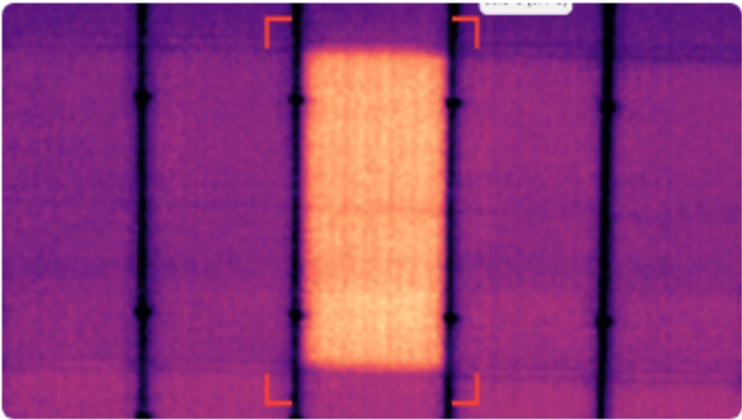

Estimated losses

After 0/12 repairs	0€/y
--------------------	------

Properties

Position	-
Severity	Major
Type	Strings
Subtype	-
Repair	To Repair

Details

Temperature Difference	+9.4°C
Average Temperature	41.4°C
Panels Affected	1


Comments

outlier
Panneau déconnecté.
12.05.2025, 09:52 a.m.


Overall location




Precize location

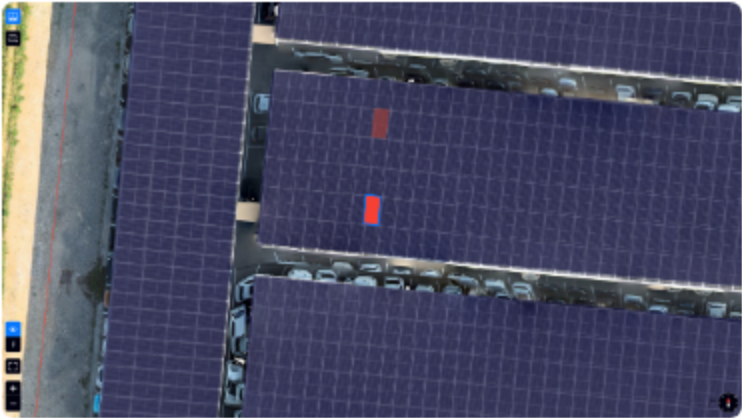

Anomaly zoom

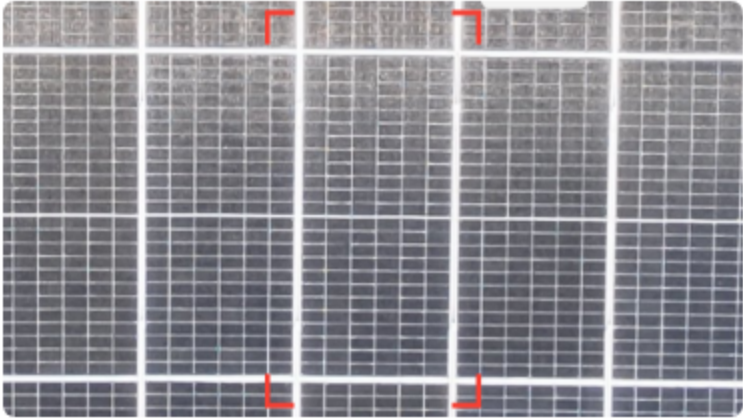

Anomaly zoom - Thermal view

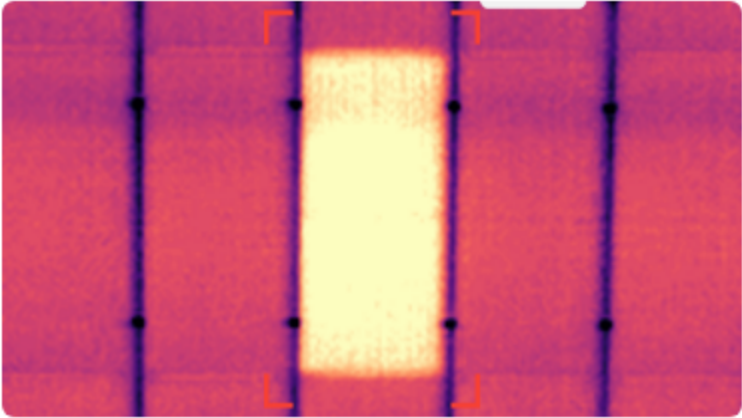

Estimated losses

After 0/12 repairs	0€/y
--------------------	------

Comments

outlier
Panneau déconnecté.
12.05.2025, 09:52 a.m.

Properties

Position	-
Severity	Major
Type	Strings
Subtype	-
Repair	To Repair


Details

Temperature Difference	+10.9°C
Average Temperature	42.9°C
Panels Affected	1


Overall location




Precize location

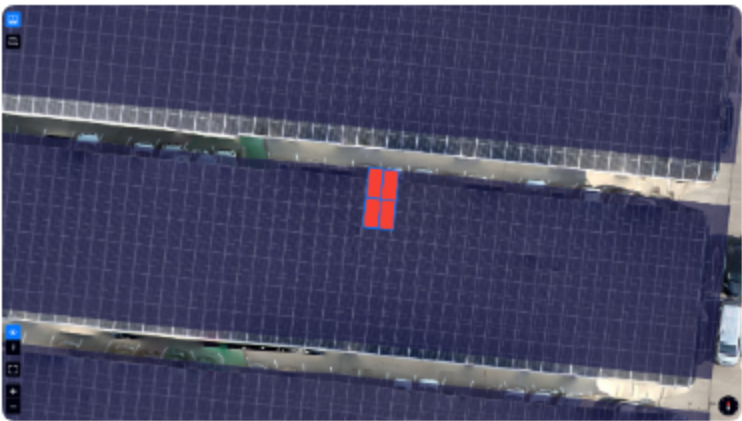

Anomaly zoom

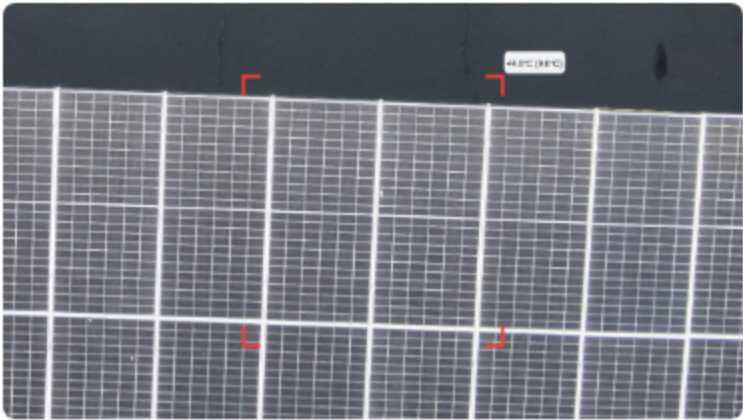

Anomaly zoom - Thermal view

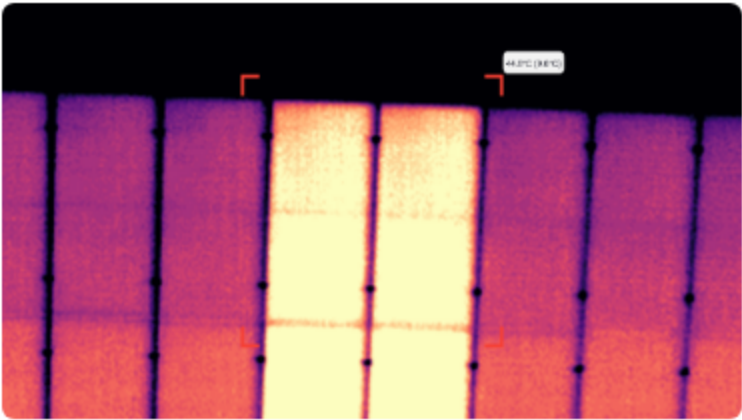

Estimated losses

After 0/12 repairs	0€/y
--------------------	------

Properties

Position	-
Severity	Major
Type	Strings
Subtype	-
Repair	To Repair

Details

Temperature Difference	+9.6°C
Average Temperature	35.2°C
Panels Affected	4

Comments

outlier
Panneaux déconnectés.
12.05.2025, 09:52 a.m.

